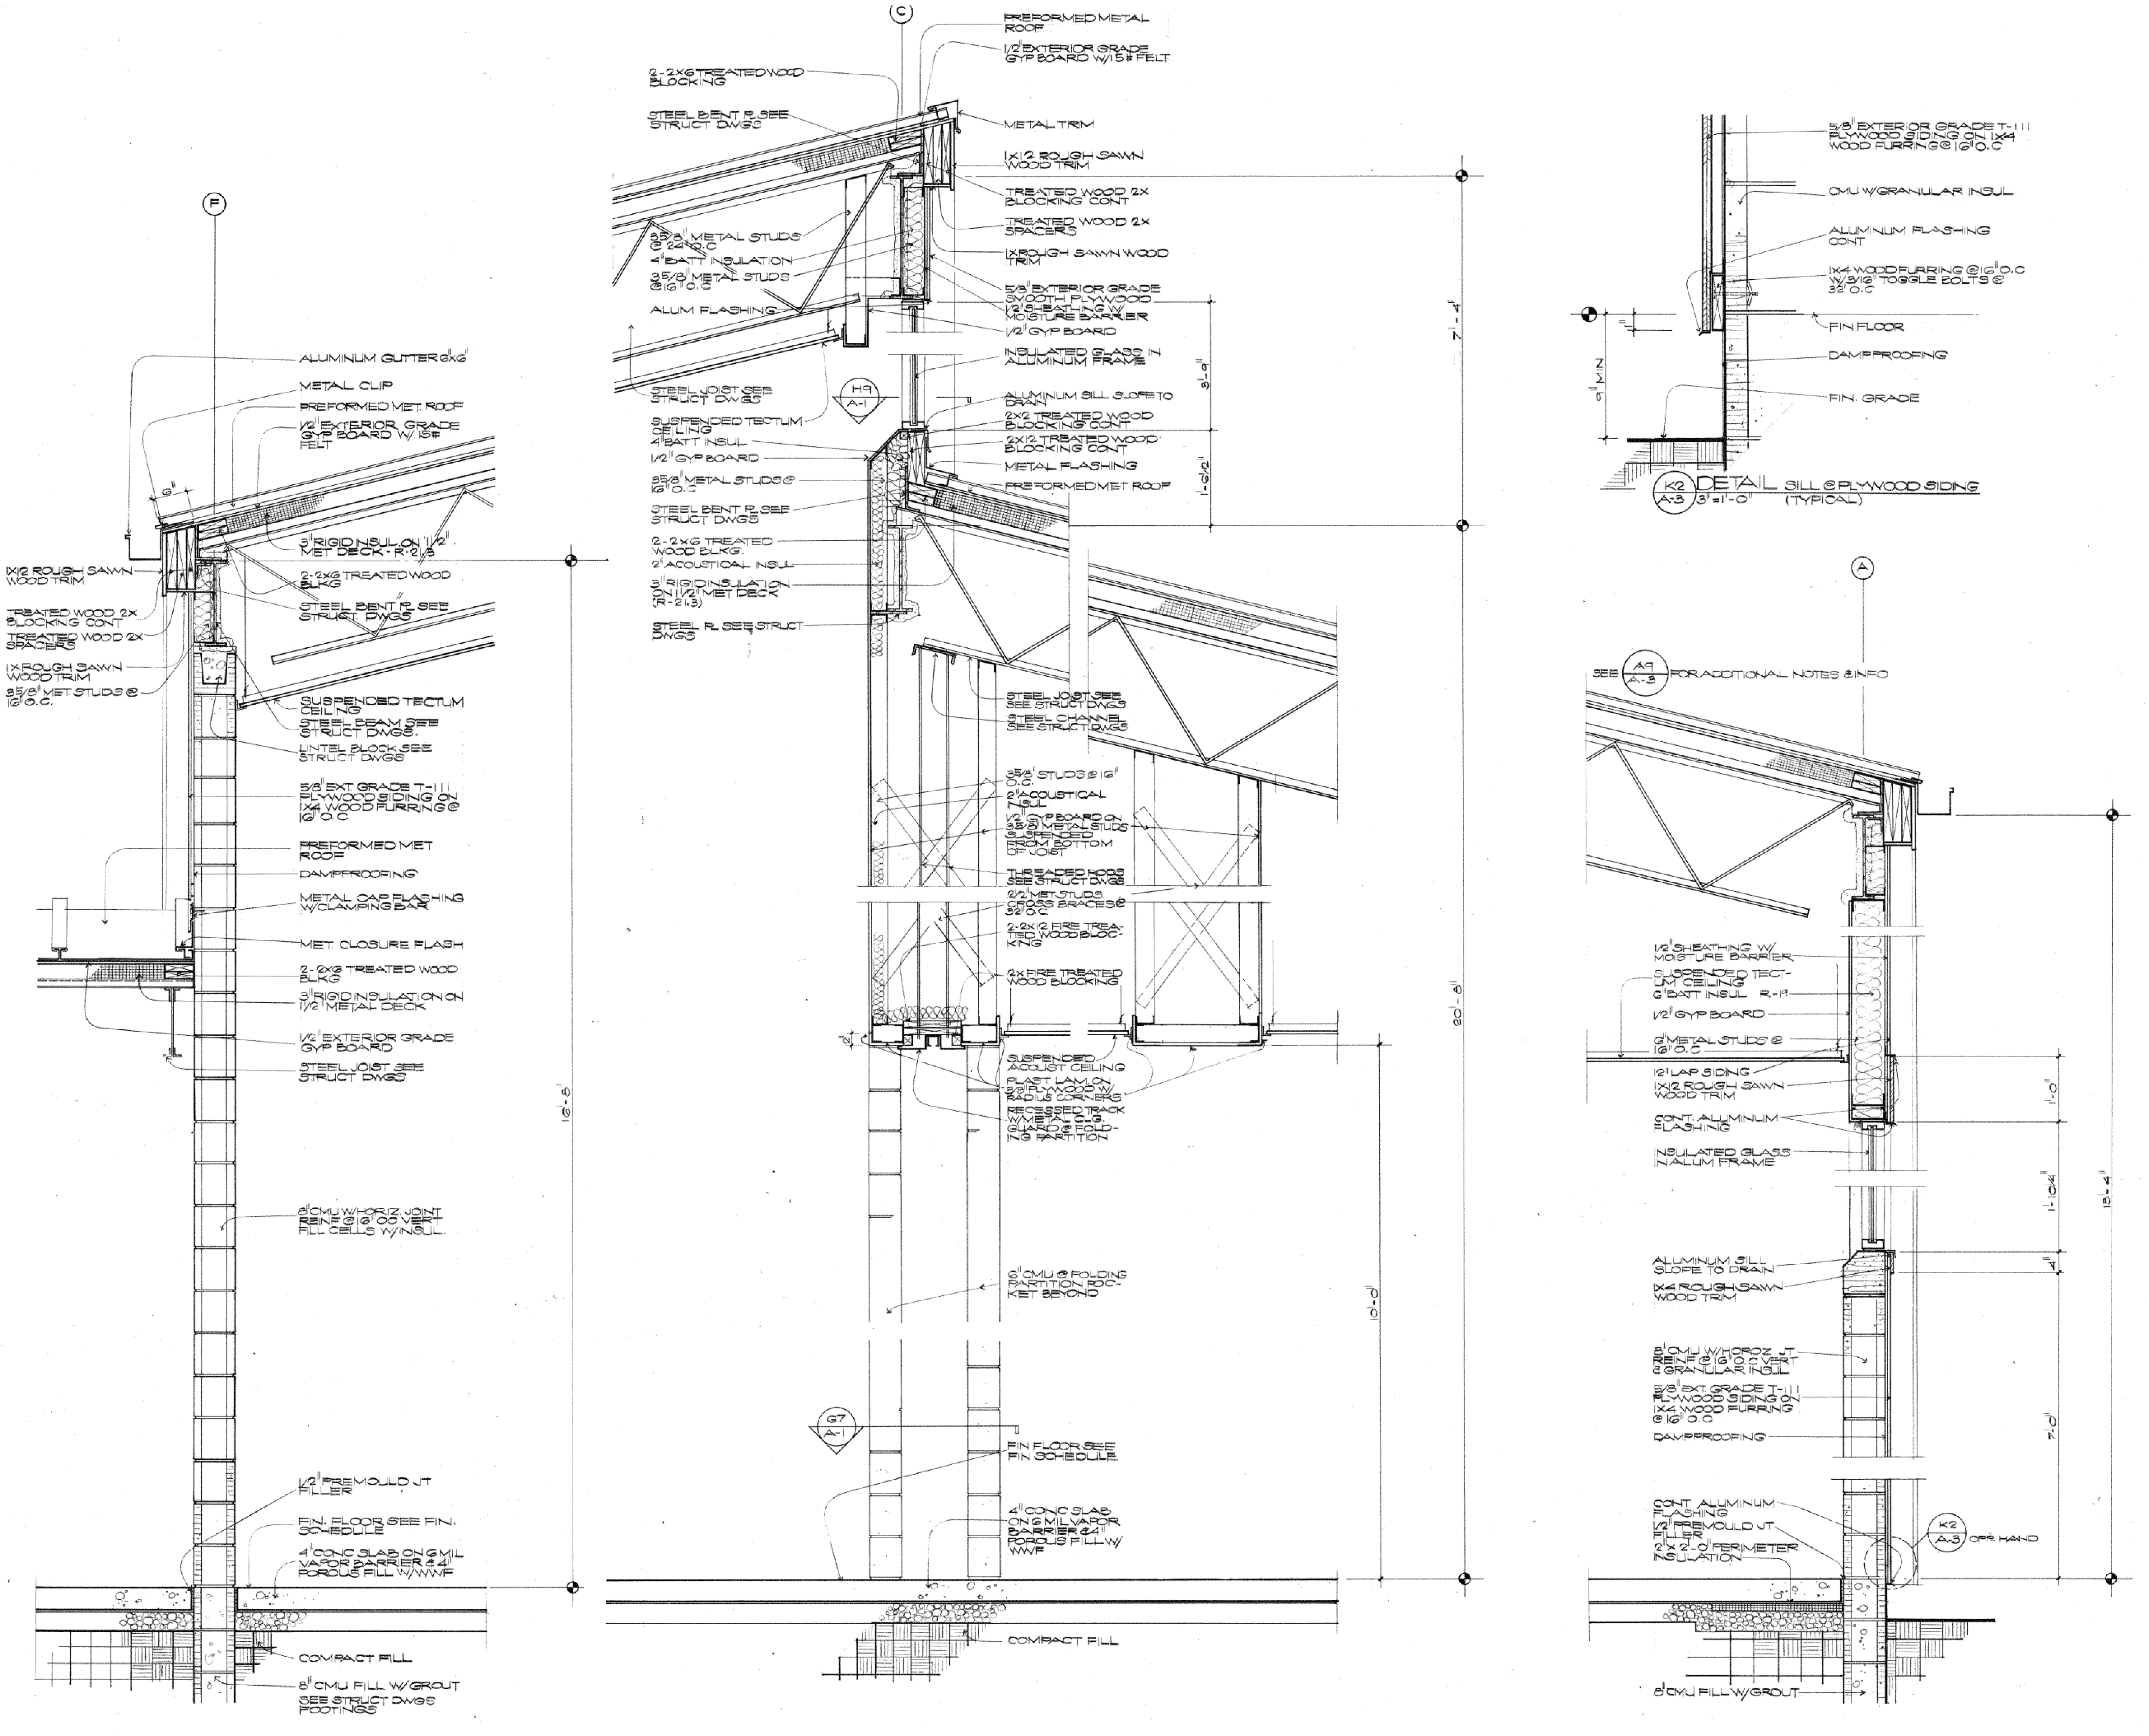

F
C
A
PREFORMED METAL ROOF
1/2" EXTERIOR GRADE GYP BOARD W/15# FELT
2-2X6 TREATED WOOD BLOCKING
STEEL BENT PL SEE STRUCT DWGS
METAL TRIM
1X12 ROUGH SAWN WOOD TRIM
TREATED WOOD 2X BLOCKING CONT
TREATED WOOD 2X SPACERS
1X ROUGH SAWN WOOD TRIM
5/8" EXTERIOR GRADE SMOOTH PLYWOOD
1/2" SHEATHING W/ MOISTURE BARRIER
1/2" GYP BOARD
3 5/8" METAL STUDS @ 24" O.C
4" BATT INSULATION
3 5/8" METAL STUDS @ 16" O.C
ALUM FLASHING
INSULATED GLASS IN ALUMINUM FRAME
ALUMINUM SILL SLOPE TO DRAIN
2X2 TREATED WOOD BLOCKING CONT
2X12 TREATED WOOD BLOCKING CONT
METAL FLASHING
PREFORMED MET ROOF
STEEL JOIST SEE STRUCT DWGS
H9
A-1
SUSPENDED TECTUM CEILING
4" BATT INSUL
1/2" GYP BOARD
3 5/8" METAL STUDS @ 16" O.C
STEEL BENT PL SEE STRUCT DWGS
2-2X6 TREATED WOOD BLKG
2" ACOUSTICAL INSUL
3" RIGID INSULATION ON 1 1/2" MET DECK (R-21.3)
STEEL PL SEE STRUCT DWGS
7'-4"
3'-9"
1'-6 1/2"
20'-8"
10'-0"
STEEL JOIST SEE STRUCT DWGS
STEEL CHANNEL SEE STRUCT DWGS
3 5/8" STUDS @ 16" O.C
2" ACOUSTICAL INSUL
1/2" GYP BOARD ON 3 5/8" METAL STUDS SUSPENDED FROM BOTTOM OF JOIST
THREADED RODS SEE STRUCT DWGS
2 1/2" MET STUDS CROSS BRACES @ 32" O.C
2-2X12 FIRE TREATED WOOD BLOCKING
2X FIRE TREATED WOOD BLOCKING
SUSPENDED ACOUST CEILING
PLAST LAM ON 3/4" PLYWOOD W/ RADIUS CORNERS
RECESSED TRACK W/METAL CLG GUARD @ FOLDING PARTITION
8" CMU @ FOLDING PARTITION POCKET BEYOND
G7
A-1
FIN FLOOR SEE FIN SCHEDULE
4" CONC SLAB ON 6 MIL VAPOR BARRIER & 4" POROUS FILL W/ WWF
COMPACT FILL
ALUMINUM GUTTER 6X6"
METAL CLIP
PREFORMED MET. ROOF
1/2" EXTERIOR GRADE GYP BOARD W/15# FELT
6"
3" RIGID INSUL ON 1 1/2" MET DECK - R-21.3
2-2X6 TREATED WOOD BLKG
STEEL BENT PL SEE STRUCT. DWGS
1X12 ROUGH SAWN WOOD TRIM
TREATED WOOD 2X BLOCKING CONT
TREATED WOOD 2X SPACERS
1X ROUGH SAWN WOOD TRIM
3 5/8" MET STUDS @ 16" O.C.
SUSPENDED TECTUM CEILING
STEEL BEAM SEE STRUCT DWGS.
LINTEL BLOCK SEE STRUCT DWGS
5/8" EXT GRADE T-111 PLYWOOD SIDING ON 1X4 WOOD FURRING @ 16" O.C
PREFORMED MET ROOF
DAMPPROOFING
METAL CAP FLASHING W/CLAMPING BAR
MET. CLOSURE FLASH
2-2X6 TREATED WOOD BLKG
3" RIGID INSULATION ON 1 1/2" METAL DECK
1/2" EXTERIOR GRADE GYP BOARD
STEEL JOIST SEE STRUCT DWGS
8" CMU W/HORIZ JOINT REINF @ 16" OC VERT FILL CELLS W/INSUL.
16'-8"
1/2" PREMOULD JT FILLER
FIN. FLOOR SEE FIN. SCHEDULE
4" CONC SLAB ON 6 MIL VAPOR BARRIER & 4" POROUS FILL W/WWF
COMPACT FILL
8" CMU FILL W/ GROUT SEE STRUCT DWGS FOOTINGS
5/8" EXTERIOR GRADE T-111 PLYWOOD SIDING ON 1X4 WOOD FURRING @ 16" O.C
CMU W/GRANULAR INSUL
ALUMINUM FLASHING CONT
1X4 WOOD FURRING @ 16" O.C W/3/16" TOGGLE BOLTS @ 32" O.C
FIN FLOOR
DAMPPROOFING
9" MIN
FIN. GRADE
K2
A-3
DETAIL SILL @ PLYWOOD SIDING
3" = 1'-0"
(TYPICAL)
SEE A9 A-3 FOR ADDITIONAL NOTES & INFO
1/2" SHEATHING W/ MOISTURE BARRIER
SUSPENDED TECTUM CEILING
6" BATT INSUL R-19
1/2" GYP BOARD
6" METAL STUDS @ 16" O.C
12" LAP SIDING
1X12 ROUGH SAWN WOOD TRIM
CONT. ALUMINUM FLASHING
INSULATED GLASS IN ALUM FRAME
ALUMINUM SILL SLOPE TO DRAIN
1X4 ROUGH SAWN WOOD TRIM
8" CMU W/HORIZ JT REINF @ 16" O.C VERT & GRANULAR INSUL
5/8" EXT. GRADE T-111 PLYWOOD SIDING ON 1X4 WOOD FURRING @ 16" O.C
DAMPPROOFING
CONT ALUMINUM FLASHING
1/2" PREMOULD JT FILLER
2" X 2'-0" PERIMETER INSULATION
K2
A-3
OPP. HAND
1'-0"
1'-10 1/4"
7'-0"
13'-4"
8" CMU FILL W/GROUT